


NOTES:

1. Score 1/4" Dummy Contraction Joints At 4'-0" Intervals.
2. Construct 1/2" Bituminous Expansion Joints At 20'-0" (Max.) Intervals.
3. Concrete Shall Be Sprayed With Liquid Curing Compound.
4. 12'-1/2" To 15'-1/2" See Electrical Details E-3 And E-4.
5. * 32' Maximum Width Is Subject To Approval On A Case By Case Basis And For Commercial Use.
6. Concrete To Be MSHA Mix No. 2.

* 32' Max.
See Note No. 5

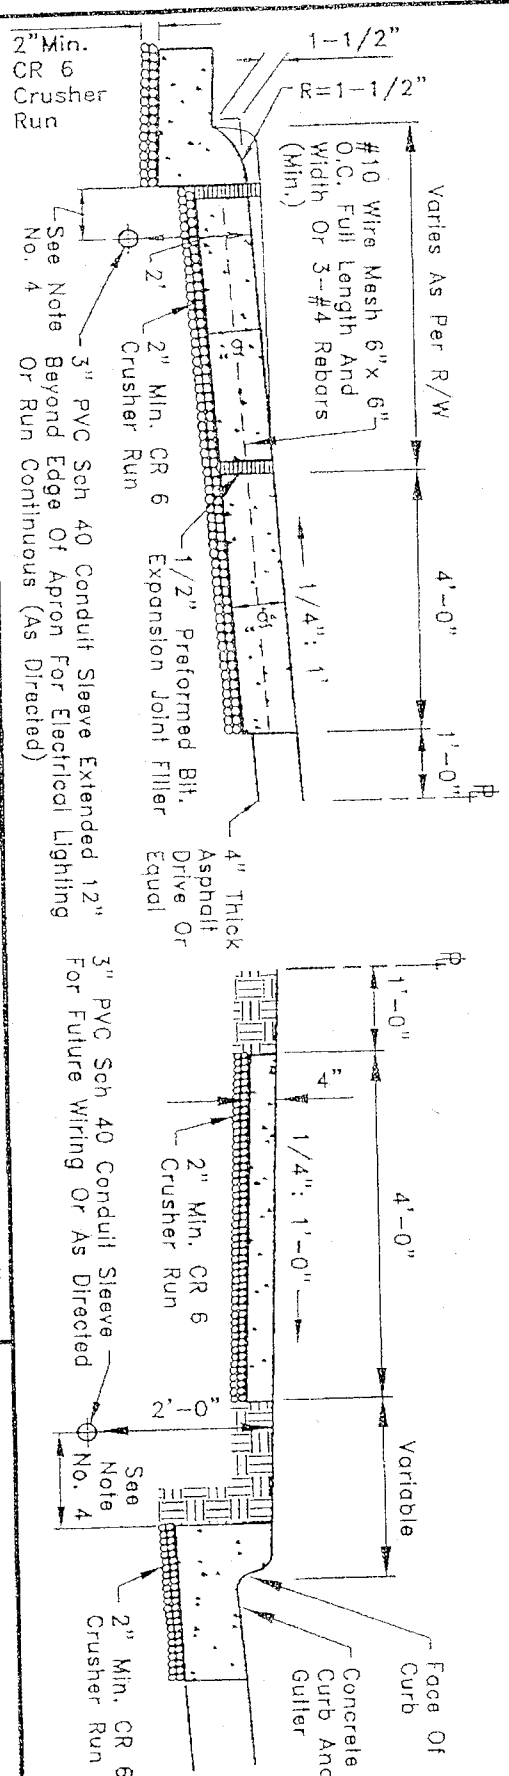

TYPICAL DRIVEWAY-CURB DETAIL
AND TYPICAL SIDEWALK LOCATION
FOR RESIDENTIAL AND
COMMERCIAL ENTRANCES

REVISIONS:	SCALE: NONE